


TYPE I WALL

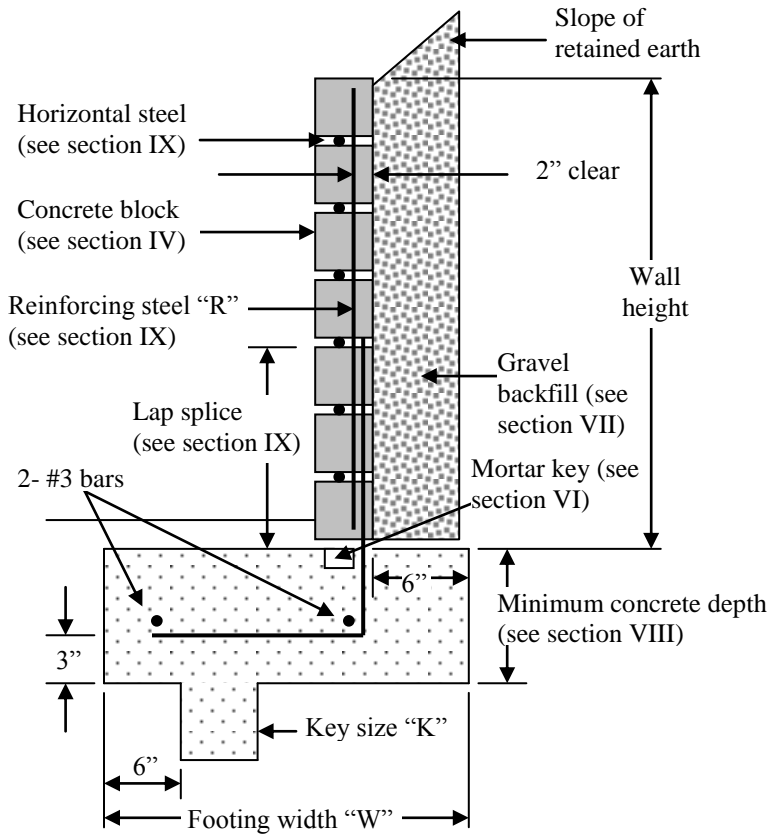

TYPE II WALL

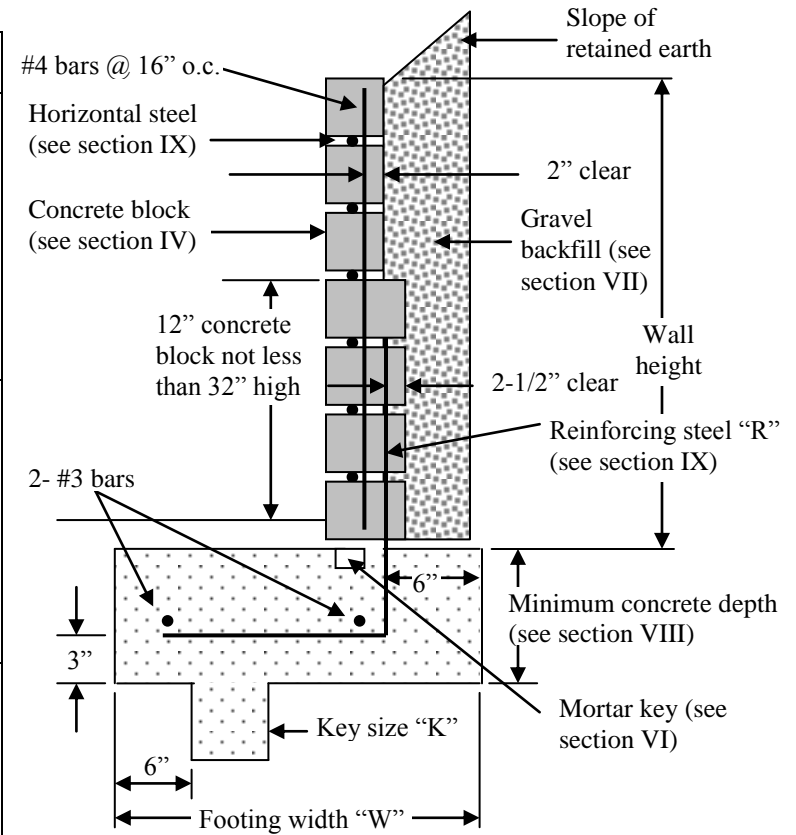


Table B	
Wall Type "T"	A – Type I, 6" Block B – Type I, 8" Block C – Type II, first 32" of block must be 12" wide masonry, regardless of wall height, 8" block for remainder.
Reinforcing Steel "R"	1 - # 3 bars @ 24" o.c. 2 - # 4 bars @ 32" o.c. 3 - # 3 bars @ 16" o.c. 4 - # 4 bars @ 24" o.c. 5 - # 4 bars @ 16" o.c. 6 - # 5 bars @ 16" o.c. 7 - # 6 bars @ 16" o.c.
Key Size "K"	D – 6" wide x 6" deep E – 8" wide x 8" deep F – 12" wide x 12" deep G – 12" wide x 18" deep N - None

Table A /Slope of Retained Earth (Horizontal run to Vertical Rise)

Wall Ht.	Level				5 to 1				4 to 1				3 to 1				2 to 1				1-1/2 to 1				1 to 1			
	T	R	K	W	T	R	K	W	T	R	K	W	T	R	K	W	T	R	K	W	T	R	K	W	T	R	K	W
1'-6"	A	1	N	1'-4"	A	1	N	1'-4"	A	1	N	1'-4"	A	1	N	1'-4"	A	1	N	1'-4"	A	1	N	1'-6"	A	1	D	1'-7"
2'-0"	A	1	N	1'-4"	A	1	N	1'-4"	A	1	N	1'-4"	A	1	N	1'-4"	A	1	N	1'-4"	A	1	D	1'-8"	A	1	D	1'-10"
2'-6"	A	1	N	1'-7"	A	1	N	1'-7"	A	1	N	1'-7"	A	1	N	1'-7"	A	1	N	1'-7"	A	1	D	1'-10"	A	1	E	2'-2"
3'-0"	A	1	N	2'-0"	A	1	N	2'-0"	A	1	N	2'-0"	A	1	N	2'-0"	A	1	D	2'-0"	A	1	E	2'-2"	B	1	F	2'-5"
3'-6"	A	1	N	2'-1"	A	1	N	2'-1"	A	1	N	2'-1"	A	3	D	2'-1"	A	3	D	2'-1"	B	1	E	2'-4"	B	4	F	2'-4"
4'-0"	B	1	N	2'-4"	B	1	N	2'-4"	B	1	N	2'-4"	B	1	D	2'-4"	B	1	D	2'-4"	B	4	F	2'-5"	B	6	G	3'-4"
4'-6"	B	1	N	2'-6"	B	2	D	2'-6"	B	2	D	2'-6"	B	2	D	2'-6"	B	4	E	2'-6"	B	6	F	3'-1"	C	5	G	3'-9"
5'-0"	B	4	D	2'-9"	B	4	D	2'-9"	B	5	E	2'-9"	B	5	E	2'-9"	B	6	F	2'-9"	C	5	G	3'-5"				
5'-6"	B	5	D	3'-0"	B	6	D	3'-0"	B	6	E	3'-0"	B	6	E	3'-0"	C	5	F	3'-2"	C	5	G	3'-9"				
6'-0"	C	5	E	3'-3"	C	5	E	3'-4"	C	5	E	3'-4"	C	5	E	3'-4"	C	5	F	3'-6"	C	6	G	4'-2"				
7'-0"	C	5	E	3'-10"	C	5	F	3'-10"	C	6	F	3'-10"	C	6	G	3'-11"	C	7	G	4'-1"								
8'-0"	C	5	G	4'-6"																								